# T3035.10 Touch Button Fan Coil Thermostat

For 2-pipe and 4-pipe Fan Coil Units

#### Features

sma

- Manual or automatic 3-speed fan control
- On/Off control heating/cooling valves
- Auto, Heat, Cool and Ventilation modes
- Manual or automatic heating/cooling changeover
- Fan Only, Heating and Fan, Cooling and Fan options
- Universal input for external sensor or windows/energy saving contact etc.
- Automatic heating/cooling changeover via changeover sensor
- Automatic heating/cooling changeover via changeover contact
- User setpoint limitation
- Clock and time schedule functions
- Key lock
- Configurable user parameters
- Modern styling and capacitive touch buttons
- White backlight LCD
- Different colour options; black and white
- EU box flush-mount



#### Applications

30x5 Series Fan Coil Thermostats used in individual rooms or zones in buildings. It is designed for two and four pipe fan coil units. T3035 has one universal input as external sensor or open/close contact input, five relay outputs. It controls the fan coil unit depending on the internal room sensor or external return sensor temperature.

#### Notes on Usage

Please, read this datasheet carefully. T3035 thermostat safety rules in accordance with the latest technological developments designed and manufactured. To avoid injury and property damage safety warnings must be observed.

#### Security Advice-Caution

Assembly, maintenance, diagnostic and repair must be done by authorized service. The power supply of the device is 230 V AC and it has no internal fuse. External protection with max C 10 A circuit breaker required in all cases. Disconnect from power supply before separating front plate.



## **Ordering Information**

Product Code	Description	Power
Т3035.10	3 Digital Outputs (Relay) Fan Control 2 Digital Outputs (Relay) Valve Control 1 Universal Input	220 V AC

## **Technical Specification**

smallart

all smart

Power Supply	150-240 V AC 50/60 Hz
Power Consumption	Max ~3.0 VA
Electrical Connection	Terminal Connectors
Battery for Real Time Clock (RTC)	Lithium CR1220 3.3V
Measuring Range	-10°C +100°C (+14°F +212°F)
Resolution	0.1°C (1°F)
Inputs	1 Universal Input (NTC 10K or Dry Contact)
Outputs	5 Digital Output (5 x 5 (2) A Relay)
Temperature Setting	5°C 99,9°C (Adjustable) (41°F 212°F (Adjustable))
Dimensions	86 x 86 x 52 mm
Mounting	Flush Mounted (Standard EU box)


## **Mounting Location**

Thermostat is suggested to be installed indoor, a place with around 1.5m height above the floor where represents the average room temperature. It should be away from direct sunlight, any cover or any heat source, to avoid false signal for temperature control.



# $\underline{\wedge}$

## **Mounting Instructions**

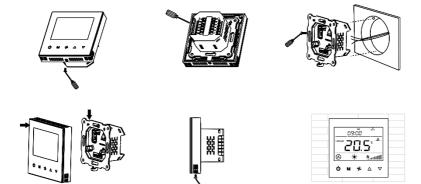



Please follow below instructions during mounting.

Step 1: Take the thermostat out from the package. Get the datasheet inside the package.

Step 2: Connect the wires well according to the wiring diagram below.

Step 3: Separate the front plate and the back plate, and then use screwdriver to fix the back plate into the electric box with 4 screws.

Step 4: Attach the front plate to the back plate, making sure the pin plates on each side are well matched.


Step 5: Refer to the picture after installation.

Step 6: Power on the thermostat to work.

Important Note 1: It is recommended to use the following flush mount boxes for better mounting: Alternative 1: Manufacturer: Viko by Panasonic, Part Number: 90926006 (Depth must be minimum 50 mm!) Alternative 2: Manufacturer: Legrand, Part Number: 0 801 21 (Depth must be minimum 50 mm!)

Important Note 2: It is recommended to use the screws included in the product box. Otherwise, there could be fitting problems during the mounting.

## **Connection Diagrams**

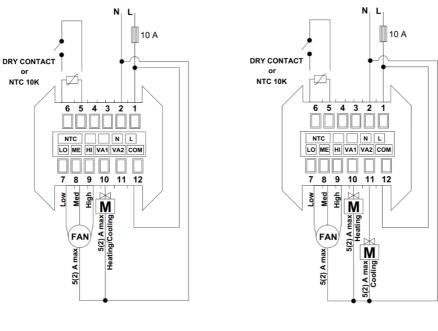


**Connection Diagram for 2-Pipe Fan Coil** 

**Connection Diagram for 4-Pipe Fan Coil** 

**Note:** Thermostat has no internal fuse. External protection with max C 10 A circuit breaker required in all cases. Isolate the cables of NTC-dry contact with L, N from 230 V power supply.



## **Display and Operations**

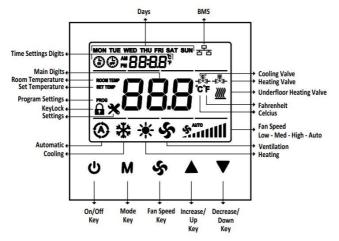

• Mode Selection: Press the "M" key to change the mode of the device. Active mode options are as follows.

	AUTOMATIC	COOL	HEAT	FAN
FAN ONLY	-	-	-	V
COOLING + FAN	-	V	-	V
2 PIPE SYSTEM	-	V	V	V
HEATING + FAN	-	-	V	V
4 PIPE SYSTEM	V	V	V	V

- Fan Selection: When the "\$" key is pressed, fan speed can be changed as Low, Med, High, Auto.
- Time Setting: When pressing the "M" key for 3 seconds, year digits flashes on the panel. "M" key is pressing once again, month digit flashes on the panel. "M" key is pressing once again, day digit flashes on the panel. "M" key is pressing once again, hour digit flashes on the panel. "M" key is pressing once again, minute digit flashes on the panel. "M" key is pressing once again, minute digit flashes on the panel. "M" key is pressing once again, minute digit flashes on the panel. "M" key is pressing once again, day of week digit flashes on the panel. Year, month, day, hour, minute, day of week can be changed by "▲" and "▼" keys.

Order: Year -> Month -> Day -> Hour -> Minute -> Day Of Week


- Schedule Operations: Be sure to set clock setting, before making schedule operation. After setting day, to enter the Schedule menu, press the "M" key one time. While in the Schedule menu, "Monday opening time hour digit" can be flashed. "M" key is pressing once again, "Monday opening time minute digit" flashes on the panel. Press the "M" key to enter the "Monday closing time hour digit" can be flashed. "M" key is pressing once again, "Monday opening time minute digit" flashes on the panel. Press the "M" key to enter the "Monday closing time hour digit" can be flashed. "M" key is pressing once again, "Monday closing time minute digit" flashes on the panel. While the digits flashing, hour and minute can be changed by "▲" and "▼" keys. Press the "M" key (one or more times) to select the other day of week.
- Key Lock Operation: When pressing "M" and "▲" key, key lock digit displays on the panel. The panel locked. When the panel is locked, press the "M" and "▲" keys to unlock panel. "Key Lock" options can be changed via parameter P6. To lock two or more buttons at the same time; sum the numbers of the buttons. To lock mode key and on/off key, 1 (on/off) and 2 (mode) should be added and written 3. To lock setpoint and fan speed, 4 (setpoint) and 8 (fan speed) should be added and written 12.



## Configuration

## **Configuration Menu Description**

When the device on or off position, press together "Main Parameter Increase Key" (**M**) and "Value Decrease Key" (▼) for 3 seconds, to enter the Configuration Menu. In the password screen, Password digits can be changed by "Main Parameter Increase Key" (M), Password value can be changed by "Value Increase Key" (▲) and "Value Decrease Key" (▼). Password must be entered as "203" and "Main Parameter Decrease Key" (S) must be pressed to confirm. When the correct password is written, the configuration menu will be entered. If the wrong password is entered, it will fail, and the password will reset. Password screen will return to main screen without an action 10 seconds. Parameter setting screen will return to main screen without any action in 30 seconds. All parameters are stored



within an EEPROM ensuring no data loss if the Thermostat is powered off.

## Energy Saving Mode (ECO Mode) (via Parameter P16)

Economy mode is activated from the authorization point (P16). When economy mode authorization is activated, the device will operate in economy mode instead of OFF state. In ECO mode, the system will operate according to the set point value for heating and cooling.

The situations that will be affected by the economy mode are as follows;

Auto mode authorization will be turned off.

Fan/Valve control will operate as Valve Dependent.

NOTE: Economy mode will not be activated when Universal Input is selected Changeover.

## Universal Input (Parameter P32)

- External Sensor for room (parameter P32 = 1)

The device operates according to external temperature sensor value read from universal input.


- External Sensor (parameter P32 = 2)

The device operates according to internal temperature sensor value. The temperature read from the universal input can be monitored from P36.

- Changeover sensor (parameter P32 = 3)

If "Universal Input" value is selected as changeover, "dead zone" cannot be used.

Changeover sensor only valid when "Fan Coil Type" is set to 2.



When the water temperature is above P34 the thermostat changes over to heating mode. It stays in heating mode until the temperature falls below P33.

When the water temperature is below P33, the thermostat changes over to cooling mode. It stays in cooling mode until the temperature rises above P34.

- Changeover contact-On/Off (NC Contact) (parameter P32 = 4)

Changeover sensor only valid when "Fan Coil Type" is set to 2.

When this contact is closed, the device will operate according to the cooling mode. When the contact is opened, it will operate according to the heating mode.

- Changeover contact-Off/On (NO Contact) (parameter P32 = 5)

Changeover sensor only valid when "Fan Coil Type" is set to 2.

When this contact is opened, the device will operate according to the cooling mode. When the contact is closed, it will operate according to the heating mode.

- Windows contact/Energy saving-On/Off (NC Contact) (parameter P32 = 6)


When this contact is closed, the device is in the "ON" position. When this condition is not met, the device shows "OPEN" on the panel and the outputs of the device are passive.

- Windows contact/Energy saving-Off/On (NO Contact) (parameter P32 = 7)

When this contact is opened, the device is in the "ON" position. When this condition is not met, the device shows "OPEN" on the panel and the outputs of the device are passive.



## Hysteresis (Parameter P40)



The output diagram of the valve according to the relation between  $T_s$  and  $T_R$  is given below.

## Fan/Valve Control Selection (Parameter P41)

In valve independent mode, the fan operates according to manual fan selection or automatic fan control. When valve is closed, the fan will go on to operate.

In valve dependent mode, the fan will be closed when the valve is closed. If the valve is open, the fan will operate according to manual fan selection or automatic fan control.

## **Restore Factory Setting (Parameter P45)**

The device can load the factory setting parameters via parameter P45, by changing the value to "1", and pressing button "Exit Key" ( $\mathcal{U}$ ). The display shows top and bottom lines loaded step by step during reload process approximately 3 seconds.

## Alarms

Alarm Code will appear on the screen, during alarm. If there is more than one alarm, alarms are shown alternately. - Onboard Sensor Alarm

If the onboard sensor is broken down from the device displayed "ALO1" on the panel and "Err" on the Main Digits. During the alarm, device outputs will be closed. During the alarm, If the "Universal Input" is selected to "External Sensor", the device continues normal operation.

- External Sensor Alarm

If the "Universal Input" is selected to "External Sensor" also the sensor is broken down, displayed "ALO2" on the panel and "Err" on the Main Digits. During the alarm, device outputs will be closed. "Universal Input" is set to "Not Used" to eliminate the alarm.

- Changeover Sensor Alarm

If the "Universal Input" is selected to "Changeover Sensor" also the sensor is broken down, displayed "AL03" on the panel and "Err" on the Main Digits. During the alarm, device outputs will be closed. "Universal Input" is set to "Not Used" to eliminate the alarm.

No.	Name of Parameter	Parameter Definition	Factory Default
P1	Hardware Version	Device hardware version	2.0
P2	Firmware Version	Device firmware version	2.8
Р3	Setpoint High Limit	Range: 5°C 99,9°C (Range: 41°F 212°F)	30°C (86°F)
P4	Setpoint Low Limit	Range: 5°C 99,9°C (Range: 41°F 212°F)	5°C (41°F)
Р5	Main Screen	0 = Room temperature 1 = Setpoint temperature 2 = Swap Room Temperature and Setpoint Temperature	0

### **Configuration Menu Parameters**



		0 = Unlocked	
		1 = Lock On/Off	
		2 = Lock Mode	
		4 = Lock Setpoint	
		8 = Lock Fan Speed	
P6	Key Lock	16 = Lock Time Settings	0
		32 = Lock Time Schedule Settings	
		63 = Locked All	
		(*) To lock two or more buttons at the same time; sum the numbers	
		of the buttons. To lock setpoint and fan speed, 4 (Setpoint) and 8 (Fan	
		Speed) should be added and written 12.	
P7	Celsius or Fahrenheit	0 = Celsius	0
P7	Ceisius of Famelineit	1 = Fahrenheit	0
		0 = 24 hours clock	
P8	Time Format	1 = 12 hours clock (AM/PM)	1
PO	Time Format	(*) The system Time Format is 24 hours clock. This parameter adjusts	T
		how to clock format on the panel/screen will shows.	
P9	Time Schedule Enable	0 = Disable	1
		1 = Enable	1
		0 = Screen Saver Disabled	
		1 = Display On	
P10	Screen Saver	2 = Display Off	4
P10	Screen Saver	3 = Only Room Temperature	4
		4 = Room Temperature and Clock	
		5 = Swap Room Temperature and Setpoint with Clock	
P11	Screen Saver Mode Delay	Range: 10 150 seconds	60 sec.
P12	LCD Brightness	Range: 1 5 stage	5
P13	Buzzer Stage	Range: 0 5 stage	3
		This parameter adjusts the condition that the device will	
		continue when the power failure.	
P14	Power Failure	0 = Device starts off	2
		1 = Device starts on	
		2 = Keep State Before Power Failure	
		0 = Screen off	
		1 = Room Temperature	
P15	Screen Off State Status	2 = Room Temperature and Off	1
		3 = Room Temperature and Clock	
P16	ECO Mode Activation	0 = Eco Mode authorization turned off	0
		1 = Eco Mode authorization turned on	
	ECO Mode Cooling Mode Set		21°C
P17	Point	Set Point Low Limit Set Point High Limit	(69,8°F)
P18	ECO Mode Heating Mode Set	Set Point Low Limit Set Point High Limit	21°C
	Point	· · · · · · · · · · · · · · · · · · ·	(69,8°F)
P19			
	Reserved	-	-
P26			
P27		0 = Underfloor heating disable	0
P27	Underfloor Heating Activation	1 = Underfloor heating enable	U
		0 = Normal Direct	6
P28	VA1 Direction	1 = Reverse Direct	0
_		0 = Normal Direct	
P29	VA2 Direction	1 = Reverse Direct	0
		0 = Fan Only	
P30	Fan Coil Type	1 = 2 pipe system Cooling + Fan	4
		T = 2 hibe system cooling + 1 an	



		2 = 2 pipe system	1 1
		3 = 2 pipe system Heating + Fan	
		4 = 4 pipe system	
		Range: -10°C 10°C and 0.1°C steps	010
P31	Internal Temperature Sensor Calibration	5	0°C
	Calibration	(Range: -18°F 18°F and 1°F steps)	(0°F)
		0 = Not used	
		1 = External Temperature sensor for room (NTC 10K)	
		2 = External Temperature sensor (NTC 10K) (Monitoring	
		purpose)	
P32	Universal Input	3 = Changeover sensor (NTC 10K)	0
		4 = Changeover contact-On/Off (NC Contact)	
		5 = Changeover contact-Off/On (NO Contact)	
		6 = Windows contact/Energy saving-On/Off (NC Contact)	
		7 = Windows contact/Energy saving-Off/On (NO Contact)	
P33	Changeover Temperature for	Range: 10°C 25°C. Only valid when P32 is set to 3	16°C
	Cooling	(Range: 50°F 77°F. Only valid when P32 is set to 3)	(60°F)
P34	Changeover Temperature for	Range: 26°C 45°C. Only valid when P32 is set to 3	28°C
134	Heating	(Range: 78°F 113°F. Only valid when P32 is set to 3)	(82°F)
P35	Mode Change Delay	Range: 0 255 minutes	3 min.
P36	Universal Input Temperature	If P32 is "1", "2" or "3", this parameter shows the sensor	0°C
F 30	oniversal input reinperature	temperature.	(0°F)
P37	Universal Input Temperature	Range: -10°C 10°C and 0.1°C steps	0°C
P3/	Calibration	(Range: -18°F 18°F and 1°F steps)	(0°F)
		0 = Disable	
P38	Auto Mode Enable	1 = Enable	1
		Only valid when P30 is set to 4	
P39	Dead Zone	Range: 0°C 15°C. Only valid when P38 is set to 1	2°C
P39	Dead zone	(Range: 0°F 27°F. Only valid when P38 is set to 1)	(3°F)
P40	1 konta na sia	Range: 0°C 15°C	1°C
P40	Hysteresis	(Range: 0°F 27°F)	(1°F)
P41	Fan/Valve Control Selection	0 = Valve independent	1
P41		1 = Valve dependent	T
P42	Fan Stage Change Delay	Range: 0 5 seconds	2 sec.
P43	Fan Off Delay	Range: 0 60 seconds	0 sec.
P44	Reserved	-	-
DAF	Destant Fastant Catting	0 = Factory Setting Disable	0
P45	Restore Factory Setting	1 = Factory Setting Started	0
P46			
	Reserved	-	-
P48			
		Range: 001 999	
P49	Parameter Menu Password	(Read Only)	203
		1 4 11	





## Dimensions (mm)

